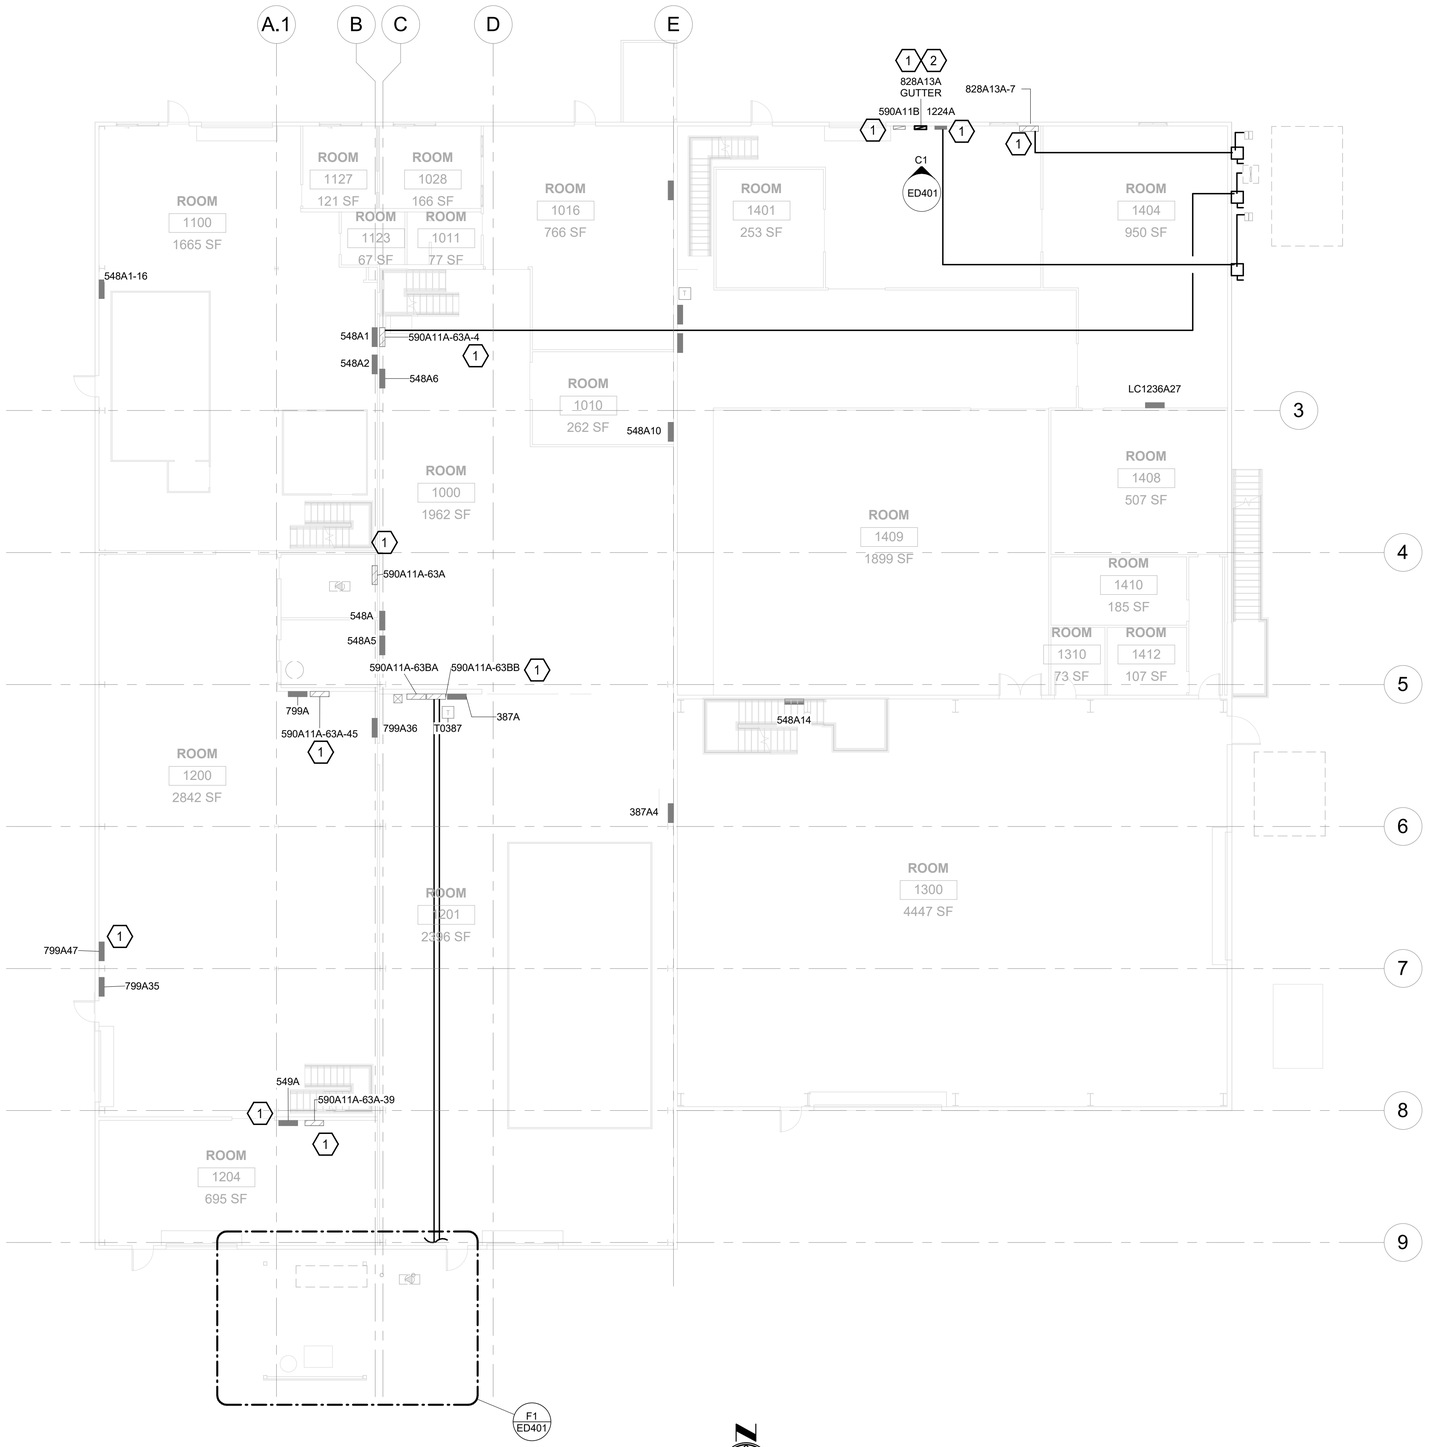

F1 ELECTRICAL DEMOLITION PLAN - FIRST FLOOR

F1 / ED101

SCALE: 3/32" = 1'-0"

0 8' 16' 24'

SCALE IN FEET

GENERAL NOTES

1. FOR GENERAL NOTES, SYMBOLS, AND ABBREVIATIONS, REFER TO SHEET E-001.
2. UNLESS OTHERWISE NOTED, LIGHT LINEWEIGHT INDICATES EXISTING EQUIPMENT TO REMAIN AND HEAVY LINEWEIGHT INDICATES DEMOLITION WORK.
3. SUBCONTRACTORS MUST FIELD VERIFY LOCATION OF EXISTING EQUIPMENT AND EQUIPMENT TO BE DISCONNECTED AND REMOVED.
4. SUBCONTRACTOR MUST FIELD VERIFY CIRCUITS INDICATED AND LOADS SERVED BY THEM.
5. SUBCONTRACTORS MUST WORK CLOSELY WITH MECHANICAL SUBCONTRACTOR TO VERIFY PHASING OF DEMOLITION. THIS IS TO AVOID ANY UNNECESSARY OR UNPLANNED OUTAGES FOR EQUIPMENT OR THE FACILITY.
6. SUBCONTRACTOR MUST REFER TO DIVISION 1 SPECIFICATIONS FOR CONSTRUCTION SEQUENCING AND PHASING.
7. REFER TO SHEETS E-801, E-802 AND E-803 FOR ADDITIONAL WORK AT ELECTRICAL PANELS.
8. CONDUIT ROUTING IS FOR DIAGRAMMATIC PURPOSE ONLY. SUBCONTRACTOR MUST VERIFY EXACT CONDUIT ROUTES
9. DEMOLITION WORK MUST COMPLY WITH NEC ARTICLE 725.25 AND 800.25.

(#) KEYED NOTES

1. EXISTING PANEL TO BE AFFECTED BY THIS PROJECT. COORDINATE SHUTDOWN WITH SUBCONTRACT TECHNICAL REPRESENTATIVE DURING CONSTRUCTION. SEE SHEET E-801, E-802 AND E-803 FOR ADDITIONAL WORK.
2. DISCONNECT AND REMOVE EXISTING GUTTER, CONDUCTORS, DISCONNECT SWITCH, VFDS AND PLATFORM SERVING EXISTING EQUIPMENT BACK TO SOURCE PANEL. EXISTING CONDUIT MUST REMAIN AND TO BE REUSED FOR NEW WORK.

Sheet Title
ELECTRICAL DEMOLITION PLAN - FIRST FLOOR

Dwg. No.
PLE2021-0432-0004D

Sht. No.
ED101