


GENERAL NOTES:


- ALL DUCTBANK INSTALLATION SHALL BE IN ACCORDANCE WITH CPUC GENERAL ORDER NO. 128.
- REFER TO DWG NX-200 FOR CONDUIT SCHEDULE.
- CONFIRM DUCTBANK DESIGN, INCLUDING MAINTENANCE HOLE AND PULLBOX PLACEMENT, WITH THE ENGINEER PRIOR TO CONSTRUCTION.
- CONTRACTOR TO CONFIRM LOCATION OF ALL UTILITIES PRIOR TO COMMENCEMENT OF WORK.
- MINIMUM 42" COVER BELOW BOTTOM OF RAIL UNDER GUIDEWAY; MINIMUM 42" COVER BELOW FINISHED GRADE IN CITY STREETS.
- REFER TO DWG UR-3C-301, UR-3C-302, CD-3B-301 AND CD-3B-302 FOR PROPOSED AND EXISTING UTILITY SIZE AND OFFSETS.
- BLANKET PROTECTION FOR CROSSING PIPES SHALL CONFORM TO 2009 STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION DWG 225-2.
- REFER TO STATION ELECTRICAL DWGS FOR CONTINUATION OF CONDUIT IN PLATFORM AND C/S ROOM. REFER TO TPSS DWGS FOR CONTINUATION OF CONDUIT IN TPSS.
- DUCTBANK DESIGN IS BASED ON 85% COMMUNICATIONS DESIGN.

SRJV
JUN 14 2013
ISSUED FOR
CONSTRUCTION

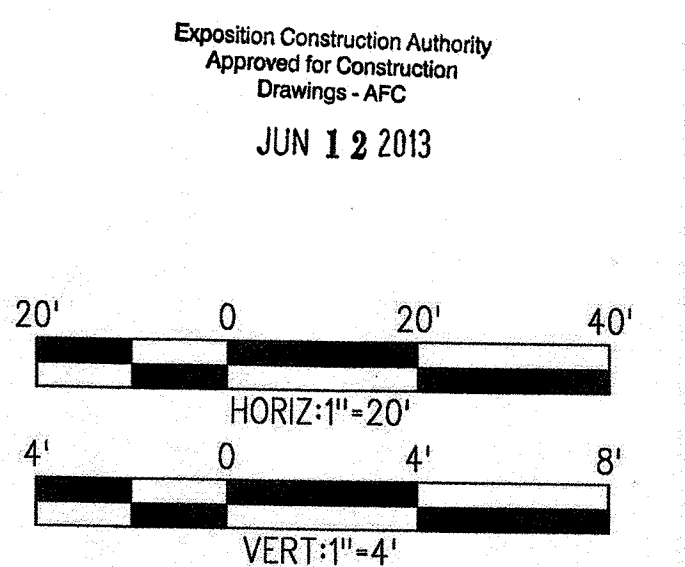

REV	DATE	BY	APP	REG NO	EXPIRES	WILLIAM A. WARD JR	SEAL HOLDER	DESCRIPTION
0	5/2/13	RJ	WW	C71818	12/31/2013	WILLIAM A. WARD JR		APPROVED FOR CONSTRUCTION

DESIGNED BY
R. JOHNSON
DRAWN BY
C. RACELIS
CHECKED BY
R. JOHNSON
IN CHARGE
W. WARD
DATE
5/2/13

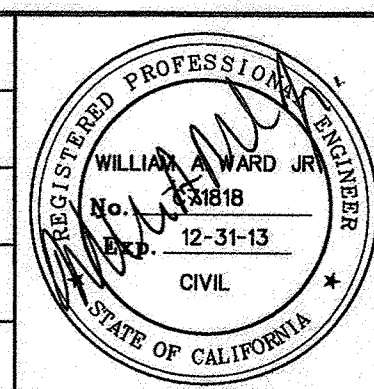

Exposition Metro Line Construction Authority
Expo

444 South Flower Street
Suite 2200
Los Angeles, CA 90071
TEL (213) 443-7463
FAX (213) 362-9481

**PARSONS
BRINCKERHOFF**

TOCO SYSTEMS

CONTRACT NO XP8902-002	
DRAWING NO NX-3C-301	REV 0
SCALE HORIZ: 1"=20' VERT: 1"=4'	
SHEET NO	