



GENERAL NOTES:

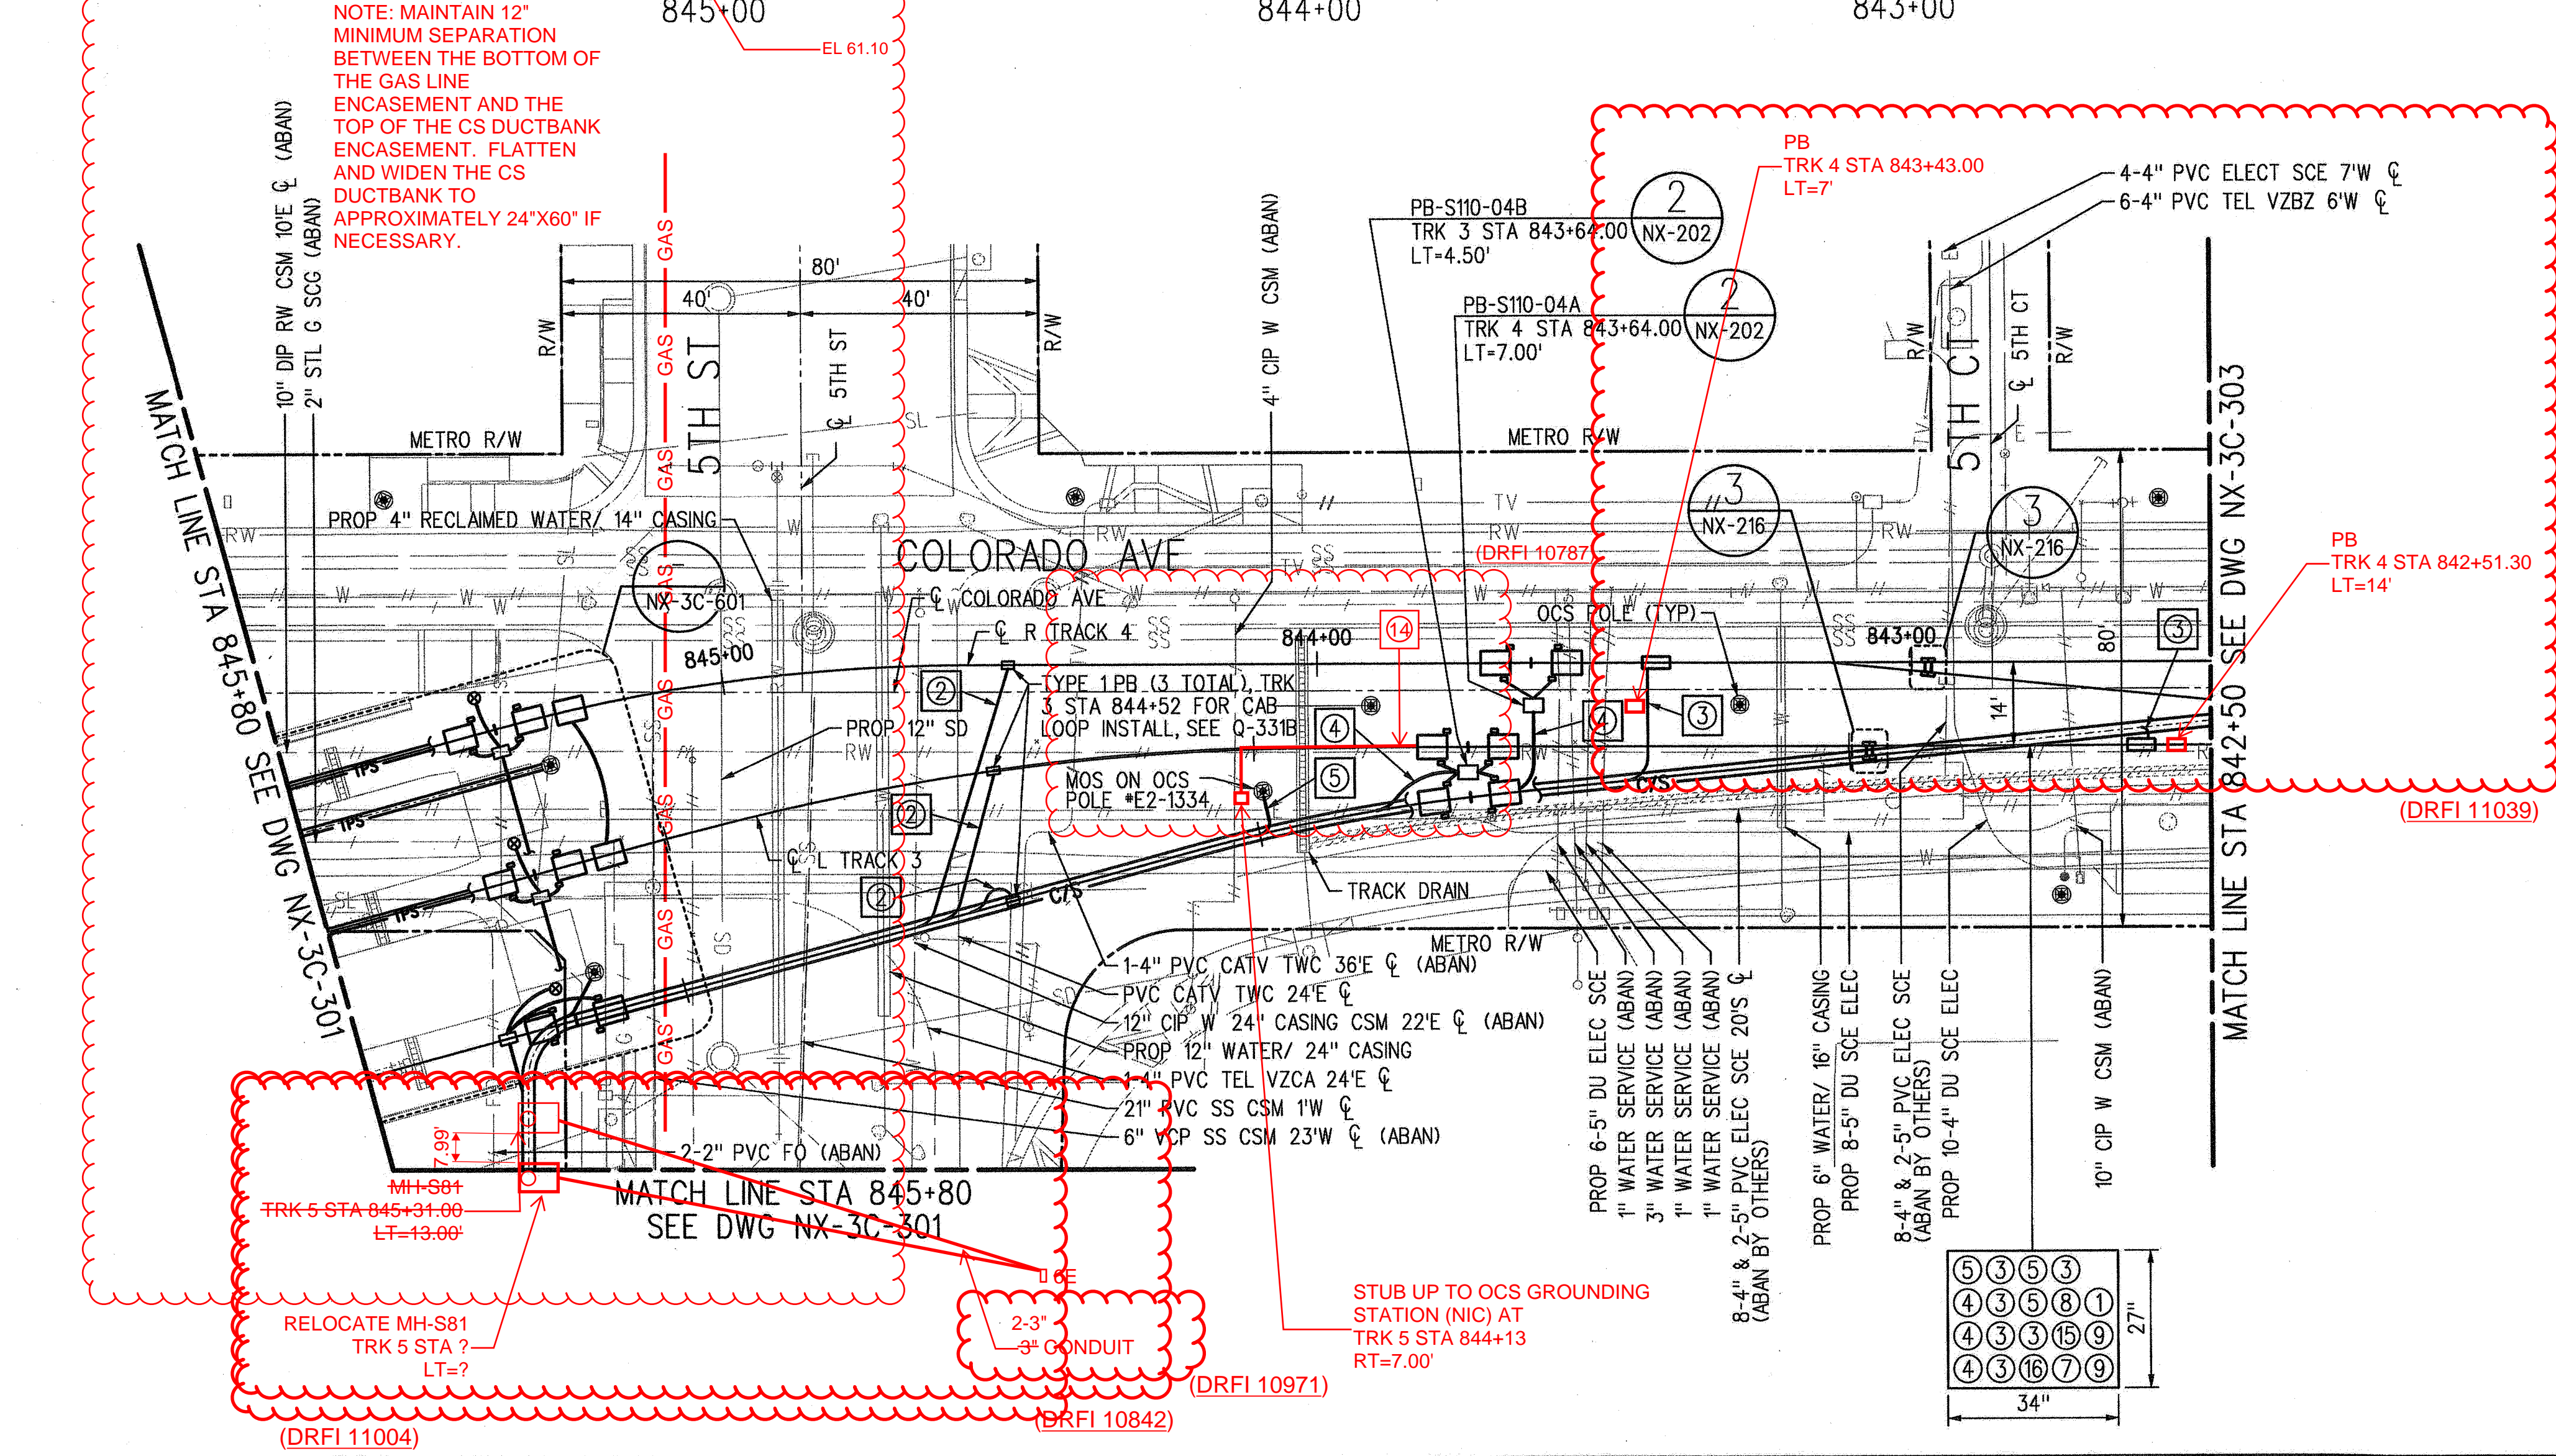


1. ALL DUCTBANK INSTALLATION SHALL BE IN ACCORDANCE WITH CPUC GENERAL ORDER NO. 128.
2. REFER TO DWG NX-200 FOR CONDUIT SCHEDULE.
3. CONFIRM DUCTBANK DESIGN, INCLUDING MAINTENANCE HOLE AND PULLBOX PLACEMENT, WITH THE ENGINEER PRIOR TO CONSTRUCTION.
4. CONTRACTOR TO CONFIRM LOCATION OF ALL UTILITIES PRIOR TO COMMENCEMENT OF WORK.
5. MINIMUM 42" COVER BELOW BOTTOM OF RAIL UNDER GUIDEWAY; MINIMUM 42" COVER BELOW FINISHED GRADE IN CITY STREETS.
6. REFER TO DWG UR-3C-302, UR-3C-303, CD-3B-302 AND CD-3B-303 FOR PROPOSED AND EXISTING UTILITY SIZE AND OFFSETS.
7. BLANKET PROTECTION FOR CROSSING PIPES SHALL CONFORM TO 2009 STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION DWG 225-2.
8. REFER TO TRAIN CONTROL INSTALLATION DWGS FOR IMPEDANCE BOND INSTALLATION, SIGNAL INSTALLATION, SWITCH MACHINE INSTALLATION AND NEGATIVE RETURN INSTALLATION.
9. DUCTBANK DESIGN IS BASED ON 85% COMMUNICATIONS DESIGN.

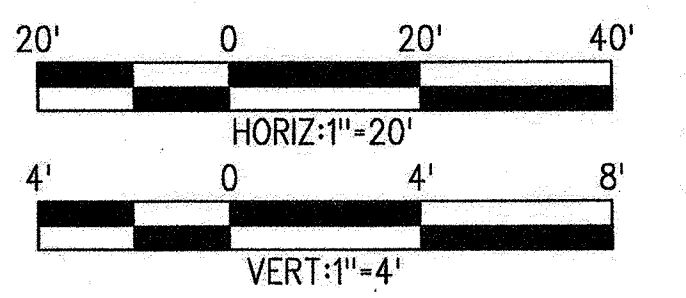

SRJV
JUN 06 2013
ISSUED FOR
CONSTRUCTION



Exposition Construction Authority
Approved for Construction
Drawings - AFC
JUN 04 2013

								DESIGNED BY R. JOHNSON			 Exposition Metro Line Construction Authority Expo			444 South Flower Street Suite 2200 Los Angeles, CA 90071 TEL (213) 443-7463 FAX (213) 362-9481	CONTRACT NO. XP8902-002	DRAWING NO. NX-3C-302	REV 0	SCALE HORIZ:1"=20' VERT:1"=4'	SHEET NO.
								DRAWN BY C. RACELIS											
								CHECKED BY R. JOHNSON											
								IN CHARGE W. WARD											
								DATE 5/2/13											
0	5/2/13	RJ	WW	C71818	12/31/2013	WILLIAM A. WARD JR	APPROVED FOR CONSTRUCTION												
REV	DATE	BY	APP	REG NO	EXPIRES	SEAL HOLDER	DESCRIPTION												

Plot Driver: S:\PLTDRIVE

Posttable: S:\POSTPLS

EXPOSITION LRT PROJECT- PHASE 2
DUCTBANK
COLORADO AVE
PLAN & PROFILE
STA 842+50 TO STA 845+75